

General Specifications


Model UT130, UT150 Temperature Controllers



GS 05C01E02-01E

■ GENERAL

UT100 series temperature controllers provide only the functions and size you require for your application. 1/16 DIN sizes is available. Easy-to-read displays show input and the setpoint. T/C or RTD inputs are standard and the output type is selectable: ON/OFF, voltage pulse or DC current. The controllers operate in an Automatic mode only. Optional alarm contact outputs, retransmission output, contact input setpoint selection and RS485 communication are available. Each features dynamic self-tuning function for easy start up. Super Control fuzzy logic for overshoot suppression is a proven champion.

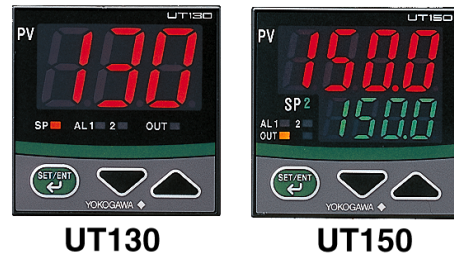

■ MODEL AND SUFFIX CODES

Model	Suffix code	Description
UT130	Temperature controller
Control output for standard type (or for heating)	-R.....	Relay output (time-proportional PID or on/off control)
	-V.....	Voltage pulse output (time-proportional PID)
Control output for cooling	N.....	No cooling output (standard type)
	R.....	Relay output (time-proportional PID or on/off control)
	V.....	Voltage pulse output (time-proportional PID)
Option	/AL	Alarm outputs (2 points) (Note1)
	/HBA	Heater disconnection alarm (includes optional /AL function) (Note1) (Note2)
	/RS	Communication function (Note2) (Note3)
	/V24	Power Supply 24 V DC / 24 V AC

Note1: /AL option cannot be specified when /HBA option is specified. /HBA option already includes the /AL option.

Note2: /HBA option cannot be specified at the same time.

Note3: When specifying the /RS option, be sure to order the required number of copies of Communication Functions Instruction Manual separately. You will not be supplied and instruction manual just because you order for the /RS option

Model	Suffix code	Description
UT150	Temperature controller
Control output for standard type (or for heating)	-R.....	Relay output (time-proportional PID or on/off control)
	-V.....	Voltage pulse output (time-proportional PID) 4 to 20 mA output (continuous PID) (Note1)
	-A.....	
Control output for cooling	N.....	No cooling output (standard type)
	R.....	Relay output (time-proportional PID or on/off control)
	V.....	Voltage pulse output (time-proportional PID) 4 to 20 mA output (continuous PID)
	A.....	
Option	/AL	Alarm outputs (2 points) (Note2)
	/HBA	Heater disconnection alarm (includes optional /AL function) (Note1) (Note2) (Note3)
	/EX	SP1/SP2 switching, starting of timer, and RUN/STOP switching by external contacts(Note4)
	/RET	PV retransmission output in 4 to 20 mA (Note3)
	/RS	Communication function (Note4) (Note5)
	/V24	Power Supply 24 V DC / 24 V AC

Note1: /HBA option cannot be specified when 4 to 20 mA output (heating-side) is specified.

Note2: /AL option cannot be specified when /HBA option is specified.

/HBA option already includes the /AL option.

Note3: /HBA option and /RET option cannot be specified at the same time.

Note4: /EX option and /RS option cannot be specified at the same time.(model UT150 only)

Note5: /EX option includes contact input 1 (for switching between the SP1 and SP2 target setpoints using external contacts) and contact input 2 (for enabling the timer).

Note6: When specifying the /RS option, be sure to order the required number of copies of Communication Functions Instruction Manual separately. You will not be supplied and instruction manual just because you order for the /RS option.

■ MEASURED VALUE INPUT

The UT100 series allows you to freely change the input type by software.

Table 1.UT130 Measured Input Ranges

Input Type	Range(°C)	Range Code	Range(°F)	Range Code	
Unspecified		OFF			
Thermocouple	K	-199 to 999°C	1	-199 to 999°F	31
		0 to 600°C	2	32 to 999°F	32
		0 to 400°C	3	32 to 750°F	33
		-199 to 200°C	4	-199 to 400°F	34
	J	-199 to 999°C	5	-199 to 999°F	35
	T	-199 to 400°C	6	-199 to 750°F	36
	E	-199 to 999°C	7	-199 to 999°F	37
	L	-199 to 900°C	12	-199 to 999°F	42
U	-199 to 400°C	13	-199 to 750°F	43	
RTD	Pt100	-199 to 850°C	15	-199 to 999°F	45
		0 to 400°C	16	32 to 750°F	46
		-199 to 200°C	17	-199 to 400°F	47
		-19.9 to 99.9°C	18	-199 to 999°F	48
	JPt100	-199 to 500°C	19		

Table 2.UT150 Measured Input Ranges

Input Type	Range(°C)	Range Code(°C)	Range(°F)	Range Code(°F)	
Unspecified		OFF			
Thermocouple	K	-270 to 1370°C	1	-300 to 2500°F	31
		0.0 to 600.0°C	2	32.0 to 999.9°F	32
		0.0 to 400.0°C	3	32.0 to 750.0°F	33
		-199.9 to 200.0°C	4	-300.0 to 400.0°F	34
	J	-199.9 to 999.9°C	5	-300.0 to 2100°F	35
	T	-199.9 to 400.0°C	6	-300.0 to 750.0°F	36
	E	-199.9 to 999.9°C	7	-300.0 to 1800.0°F	37
	R	0 to 1700°C	8	32 to 3100°F	38
	S	0 to 1700°C	9	32 to 3100°F	39
	B	0 to 1800°C	10	32 to 3200°F	40
	N	-200 to 1300°C	11	-300 to 2400°F	41
	L	-199.9 to 900.0°C	12	-300 to 1600°F	42
	U	-199.9 to 400.0°C	13	-300 to 750°F	43
	Platinel 2	0 to 1390°C	14	32 to 2500°F	44
RTD	Pt100	-199.9 to 850.0°C	15	-199.9 to 999.9°F	45
		0.0 to 400.0°C	16	32.0 to 750.0°F	46
		-199.9 to 200.0°C	17	-300 to 400°F	47
		-19.9 to 99.9°C	18	-199.9 to 999.9°F	48
JPt100	-199.9 to 500.0°C	19			
DC voltage	0 to 100 mV	0.0 to 100.0	Note: Scalling is enable in the following 4 range. -1999 to 9999, -199.9 to 999.9, -199.99 to 99.99, -1.999 to 9.999	20	
	0 to 5 V	0.000 to 5.000		21	
	1 to 5 V	1.000 to 5.000		22	
	0 to 10 V	0.00 to 10.00		23	

HARDWARE SPECIFICATIONS

Measured Value (PV) Input

Input: 1 point

Input type: Universal; can be selected by software

Input accuracy (at 23±2°C ambient temperature)

- Thermocouple: ±2°C

However,

- ±4°C for thermocouple input-270 to -100°C
- ±3°C for thermocouple input-100 to 0°C
- ±5°C for type R and S (±9°C for 0 to 500°C)
- ±9°C for type B (accuracy is not guaranteed for 0 to 400°C)

- RTD: ±1°C ±1digit
- Voltage(mV, V)±0.3%

Sampling period for measured value input: 500 ms

Burn-out detection: Functions for thermocouple or RTD input (burn-out upscale only; can not be switched off)

Input resistance:

1 MΩ or greater for thermocouple or DC mV input

Approx. 1 MΩ for DC V input

Maximum allowable signal source resistance:

250 Ω for thermocouple or DC mV input 2 kΩ for DC V input

Effect of signal source's resistance: Less than

whichever is greater, ±0.2 μV/1 Ω or ±0.01% / 100 Ω

Maximum allowable wiring resistance for RTD input:

10 Ω /wire (The resistance values of three wires must be the same.)

Effect of wiring resistance: ±0.2°C / 10 Ω maximum

Allowable input voltage:

±10 V DC for thermocouple or DC mV input

±20 V DC for DC V input

Noise rejection ratio (50/60Hz)

Normal mode noise: Min. 40 dB

Common mode noise: Min. 120 dB

(Min. 90 dB for DC V input)

Error of reference junction compensation:

±1.5°C (at 15-35°C)

±2.0°C (at 0-50°C)

The reference junction compensation cannot be switched off.

Applicable Standards:

Thermocouple and resistance temperature detector

JIS/IEC/DIN (ITS90)

Response time: 2 second or less, 63% (10 - 90%)

(The time required for transmission output to reach 63% of the maximum excursion when PV abruptly changes from 10% to 90%)

Control Output

Output: 1 point (for standard type) or

2 points (for heating/cooling type)

Output type:

Choose one from (1) to (3) below:

(1) Relay contact output

Contact capacity: 3 A at 240 V AC or 3 A at 30 V DC (with resistance load)

Note : The control output really cannot be replaced by users

(2) Voltage pulse output

On voltage: 12 to 18 V DC

Off voltage: 0.1 V DC or less

load resistance:
600 Ω or greater
short-circuit current:
approx. 30 mA

(3) Current output

Output signal: 4 to 20 mA

Maximum load resistance: 600 Ω

Output accuracy: ±0.3% of span

(at 23 ±2°C ambient temperature)

Display

Measured value and setpoint display:

[UT150]

4-digit, 7-segment LED display

[UT130]

3-digit, 7-segment LED display

Switches between SP and PV display.

Character height: See the table below.

	UT130	UT150
PV display (mm)	17.5	13.5
SP display (mm)	N/A	9.0

Status indicator lamps: LEDs

Retransmission Output

The retransmission output is provided only when

the /RET option is specified, but is not available for the

UT130 or a heating/cooling type.

Output signal: PV(measured value) in 4 to 20 mA DC

Maximum load resistance: 600 Ω

Output accuracy: ±0.3% of span (at 23 ±2°C

ambient temperature)

Contact Inputs

The contact inputs are provided only when the /EX

option is specified, but are not available for the UT130.

Functions:

(1) Switching over two setpoints (SP1 and SP2)

(2) Starting a timer(See the following "Alarm Functions.")

(3) RUN/STOP switching

Specify two functions from the three functions

using parameter DIS.

Input: 2 points (with the shared common terminal)

Input type: Non-voltage contact or transistor contact input

Contact capacity: At least 12 V, 10 mA

On/off judgment: On state for 1 kΩ or less;

Off state for 20 kΩ or greater

Alarm Functions

• Alarm Functions (Option Code /AL or /HBA)

Alarm types: 22 types (Waiting action can be set

by software):

PVhigh limit, PV low limit, Deviation high limit,

Deviation low limit, De-energized on deviation high

limit, De-energized on deviation low limit, Deviation

high and low limits, High and low limits within

deviation, De-energized on PV high limit, De-energized

on PV low limit, self-diagnostic alarm, FAIL output

Alarm output: 2 relay contacts

Relay contact capacity: 1 A at 240 V AC or

1 A at 30 V DC (with

resistance load)

• Heater Disconnection Alarm Function

(Option Code /HBA)

The heater disconnection alarm is available when time-

proportional PID control or on/off control is selected.

Heater current setting range: 1 to 80 A

Alarm output: 1 relay contact (The terminals are

the same as those of the /AL option.)

On time of burn-out detection: Min. 0.2 second

Sensor: CTL-6-S-H or CTL-12-S36-8 (URD Co. Ltd.)

To be purchased separately.

• Timer Function (Option Code /EX/AL or /EX/HBA)

The output contact status changes when the preset

time has passed since "TMR" contact turned on. The

contact action can be selected by software from:

(1) Make contact - the contact closes upon time-up.

(2) Break - the contact opens upon time-up.

Input contact type: See "Contact Inputs" above.

Communication Function

The communication function is provided only when

the /RS option is specified.

• Communication Protocol

Personal computer link: Used for communication with

a personal computer, or UT link module of the FA-M3

controller (from Yokogawa Electric Corporation).

Ladder communication: Used for communication

with a ladder communication module of the FA-M3,

or a programmable controller of other manufacturers.

MODBUS communication: Used for communication

with equipment featuring the MODBUS protocol.

• Communication Interface

Applicable standards: Complies with EIA RS-485

Number of controllers that can be connected:

Up to 31

Maximum communication distance: 1,200 m

Communication method: Two-wire half-duplex, startstop

synchronization, non-procedural

Baud rate: 2400, 4800, or 9600 bps

Safety and EMC Standards

Safety:

Compliant with IEC/EN61010-1 (CE), IEC/

EN61010-2-030 (CE), approved by CAN/CSA

C22.2 No.61010-1 (CSA), approved by UL61010-1.

Installation category: II, Pollution degree: 2

Measurement category: I (CAT I) (UL, CSA)

O (Other) (CE)

Rated measurement input voltage: Max. 10 V DC

Rated transient overvoltage: 1500 V (*)

* This is a reference safety standard value for

measurement category I of IEC/EN/CSA/

UL61010-1. This value is not necessarily a

guarantee of instrument performance.

EMC standards: Complies with EN61326,

EN61000-3-2, EN61000-3-3 and EN55011 (CE).

Class A Group 1.

All wires except those for the power supply and

relay contact output terminals are shielded.

During test, the controller continues to operate with

the measurement accuracy within ±20% of the range.

KC marking:

Electromagnetic wave interference prevention

standard, electromagnetic wave protection

standard compliance

Construction, Mounting, and Wiring

Construction: Dust-proof and Drip-proof front

panel conforming to IP65.

For side-by-side close installation, the controller

loses its drip-proof protection.

Casing: ABS resin and polycarbonate

Case color: Black

Mounting: Flush panel mounting

Terminals: Screw terminals

External dimensions: Refer to P.3.

Weight: UT130/UT150: Approx.200g

Power Supply and Isolation

• Power Supply (Common for All Models)

Power supply	Voltage	Rated at 100-240 V AC 24 V AC/DC when "/V24" is specified
	Frequency	50 or 60 Hz
Maximum power consumption	8 VA maximum(4W maximum) when "/V24" is specified : 3W maximum	
Memory	Non-volatile memory	
Withstanding voltage	Between primary terminals and secondary terminals (See Notes 1 and 3.)	CE: 3000 V AC for 1 minute (Between relay terminals and secondary terminals 1500 V AC for 1 minute) UL/CSA: 1500 V AC for 1 minute (Note 2)
Insulation resistance	Between primary terminals and secondary terminals (See Notes 1 and 3.)	20 M Ω or more at 500 V DC

Note 1 : The primary terminals are the power supply terminals and

relay output terminals. The secondary terminals are the analog

input and output terminals, the voltage pulse output terminals, and

the contact input terminals.

Note 2 : The withstanding voltage is specified as 2300 V AC per

minute to provide a margin of safety.

Note 3 : 24 V power supply is the secondary terminal.


• Isolation

The bold lines below indicate reinforced insulation, and

the broken line indicates functional insulation.

In case of CE conformity, alternate long and short

dash line indicates basic insulation.

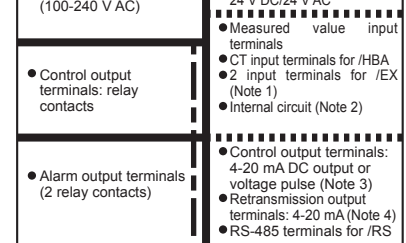

Note 1: The /EX option is not available for the UT130.

Note 2: Neither the measured value input terminals, CT input

terminals for the /HBA option, nor input terminals for the /EX option

are isolated from the internal circuit.

Note 3: The UT130 does not have the 4 to 20 mA DC output.

Note 4: The /RET option is not available for the UT130.

Environmental Conditions

• Normal Operating Conditions

Warm-up time: At least 30 minutes

Ambient temperature: 0 to 50°C (0 to 40°C when

mounted side-by-side)

Rate of change of temperature: 10°C/h or less

Ambient humidity: 20 to 90% RH (no condensation allowed)

Magnetic field: 400 A/m or less

Continuous vibrations of 5 to 14 Hz:

Amplitude of 1.2 mm or less

Continuous vibrations of 14 to 150 Hz:

4.9 m/s² (0.5G) or less

Short-period vibrations: 14.7 m/s² (1.5G) for

15 seconds or less

Shock: 98 m/s² (10G) for 11 milliseconds or less

Mounting angle: Upward incline of up to 30

degrees; downward incline is not allowed.

Altitude: 2000 m or less above sea level

• Maximum Effects from Operating Conditions

(1) Temperature effects

Thermocouple, DC mV and DC V input:

±2 μV/°C or ±0.02% of F.S./°C, whichever is the larger

Resistance temperature detector:

±0.05°C/°C or less

Analog output: ±0.05% of F.S./°C

(2) Effect from fluctuation of power supply voltage

(within rated voltage range)

Analog input: ±0.2 μV/V or ±0.002% of F.S./V,

whichever is the larger

Analog output: ±0.05% of F.S./V

• Transportation and Storage Conditions

Temperature: -25 to 70°C


Humidity: 5 to 95% RH (no condensation allowed)

Shock: Package drop height 90 cm (when packed

in the dedicated package)

FUNCTION BLOCK DIAGRAM


In this block diagram of a UT100 series controller, the shaded area functions are featured in all the UT100 series controllers including the UT130; the white area functions are featured in the UT150 controller only. When ordering, please specify the model, suffix, and option codes according to the functions required.

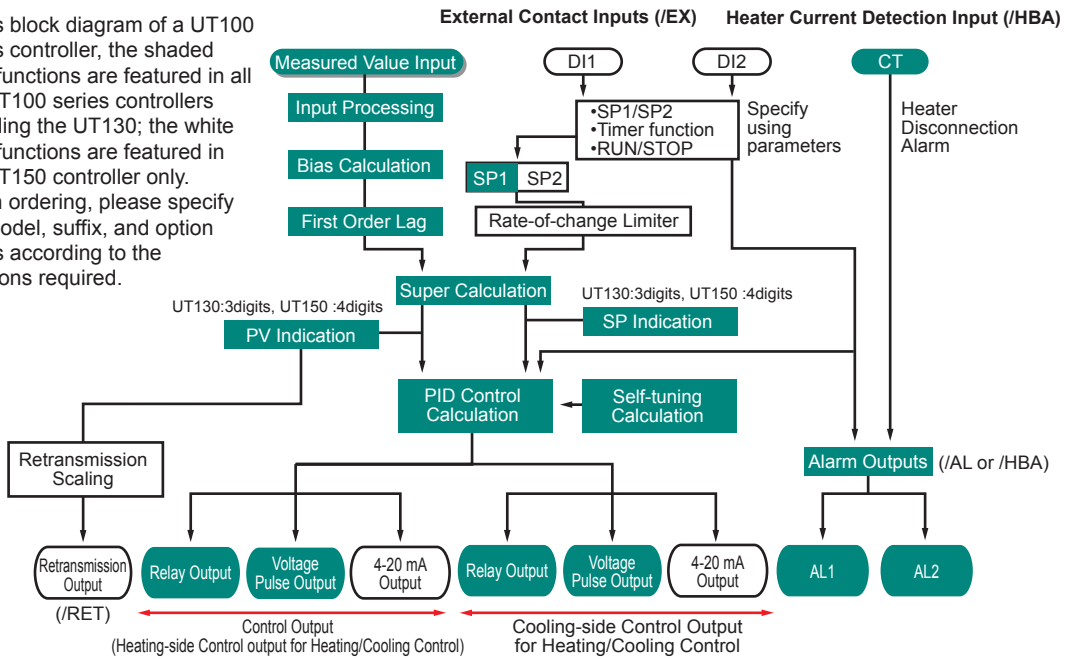

F01.ai


EXTERNAL DIMENSIONS

● UT130

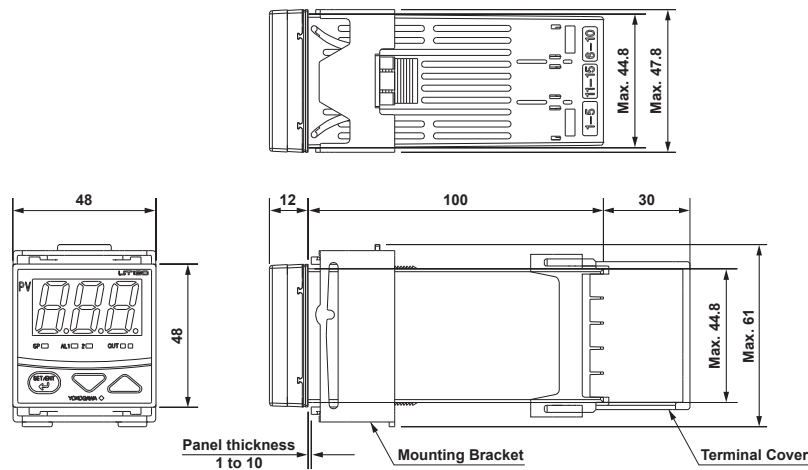


F02.ai

● UT150

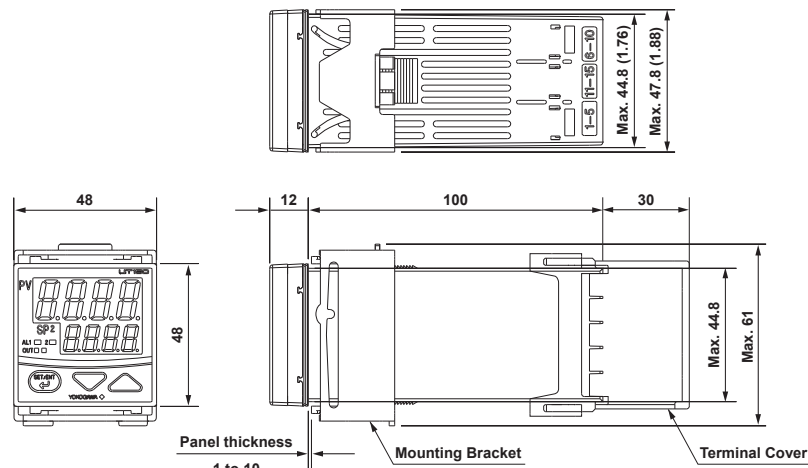


Normal Allowable Deviation= ±(Value of JIS B 0401-1999 tolerance grade IT18) /2
F03.ai

■ PANEL CUTOUT DIMENSIONS

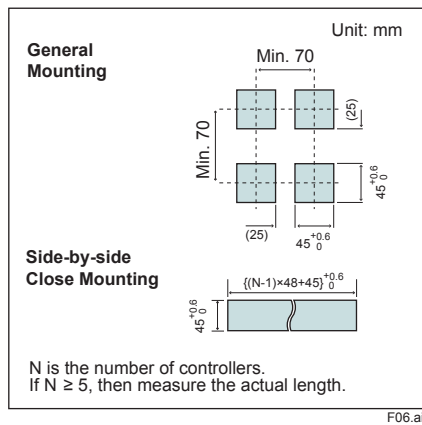


■ TERMINAL ARRANGEMENTS

UT130 Terminal Arrangement

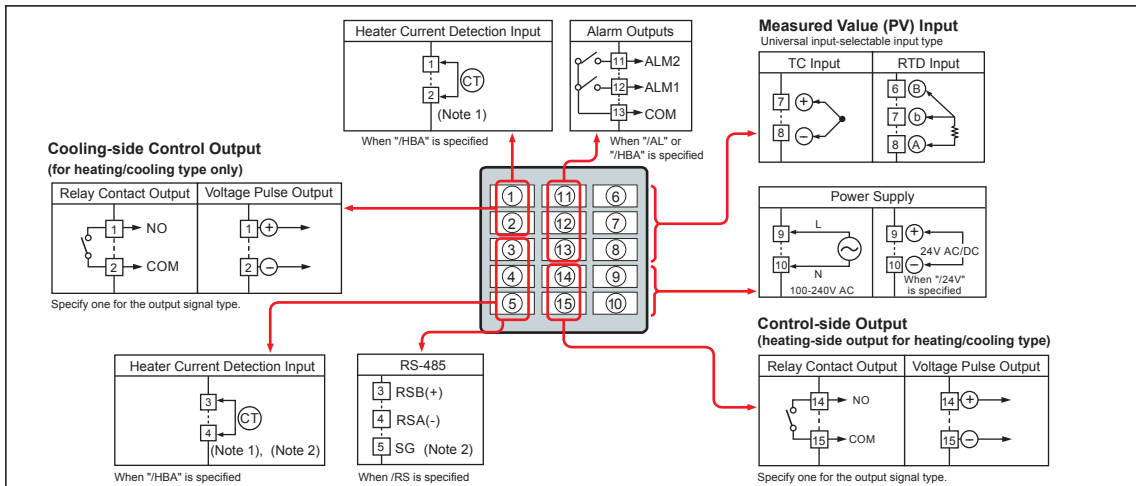

Note 1: The heater current detection input terminals (option code:/HBA)are defined as terminals 1 and 2 for a standard type and as terminals 3 and 4 for a heating/cooling type.
 Note 2:For a heating/cooling model, you are not allowed to specify both the/HBA and/RS options at the same time.

UT150 Terminal Arrangement

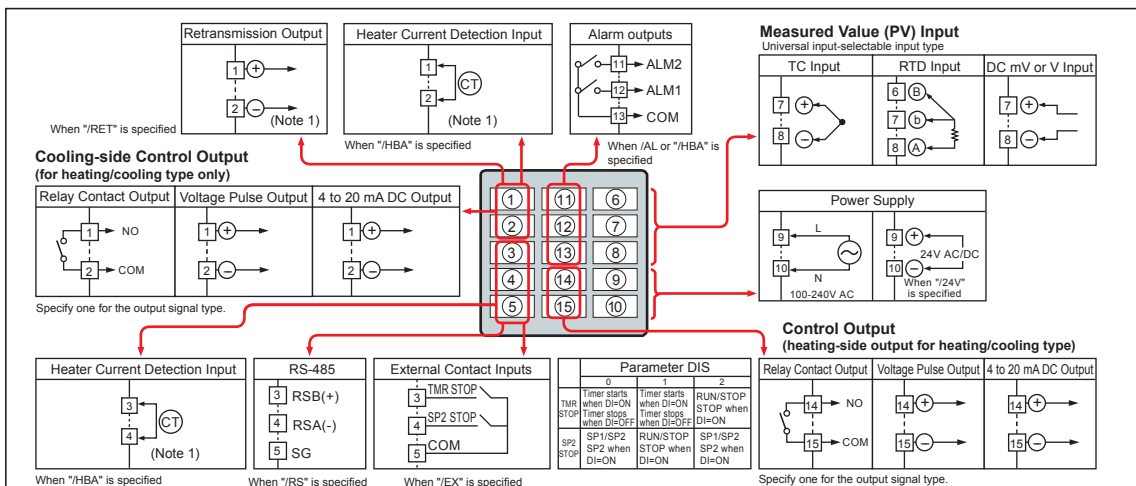

Note 1: The heater current detection input terminals(option code:/HBA)are defined as terminals 1 and 2 for a standard model, and as terminals 3 and 4 for a heating/cooling model.
 When the /RET option is specified, these terminals are defined as terminals 3 and 4.

F07.ai