


Continued from other side

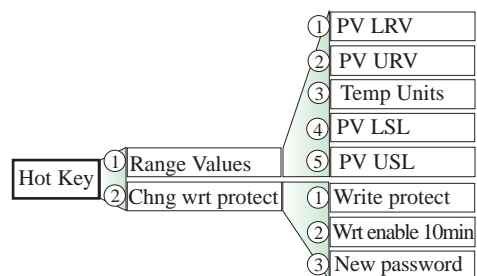

HART®
Communicating Products
include:

ADMAG
Magnetic Flowmeters

DPharp
Digital Pressure Transmitters

EXA
PH Analyzers

UNDELTA
Pressure Transmitters

YEFLO
Vortex Shedding Flowmeters

YT200 and YTA
Temperature Transmitters

YTA 110 & 310
HART Communicating
Temperature Transmitters



Basic Programming
Pocket Reference Guide

YOKOGAWA ◆

ERROR CODES

Integral Display	Error Descriptions	Action
Er.01	Output Too Low	Check LRV
Er.02	Output Too High	Check URV
Er.03	Sensor 1 Failure	Check connections or replace sensor 1
Er.05	S1 Signal Error	Check sensor connections and sensor type
Er.07	Ambient Temp Low	Use heat source to raise temp of transmitter
Er.08	Ambient Temp High	Move transmitter away from heat source
Er.10	Illegal PV Map	Correct PV mapping
Er.11	Term Sensor Failure	Contact service personnel
Er.12	EEPROM Failure	Contact service personnel
Er.13	CPU Failure	Contact service personnel
Er.14	A/D Failure	Contact service personnel

[E] = Execute
 [R] = Read Only
 [S] = Select
 [W] = Read and Write

YOKOGAWA
2 Dart Road
Newnan, GA 30265
770.254.0400

YTA110/310 HART COMMUNICATIONS PROGRAMMING

